


Disinfection by Product Results at Point of Entry

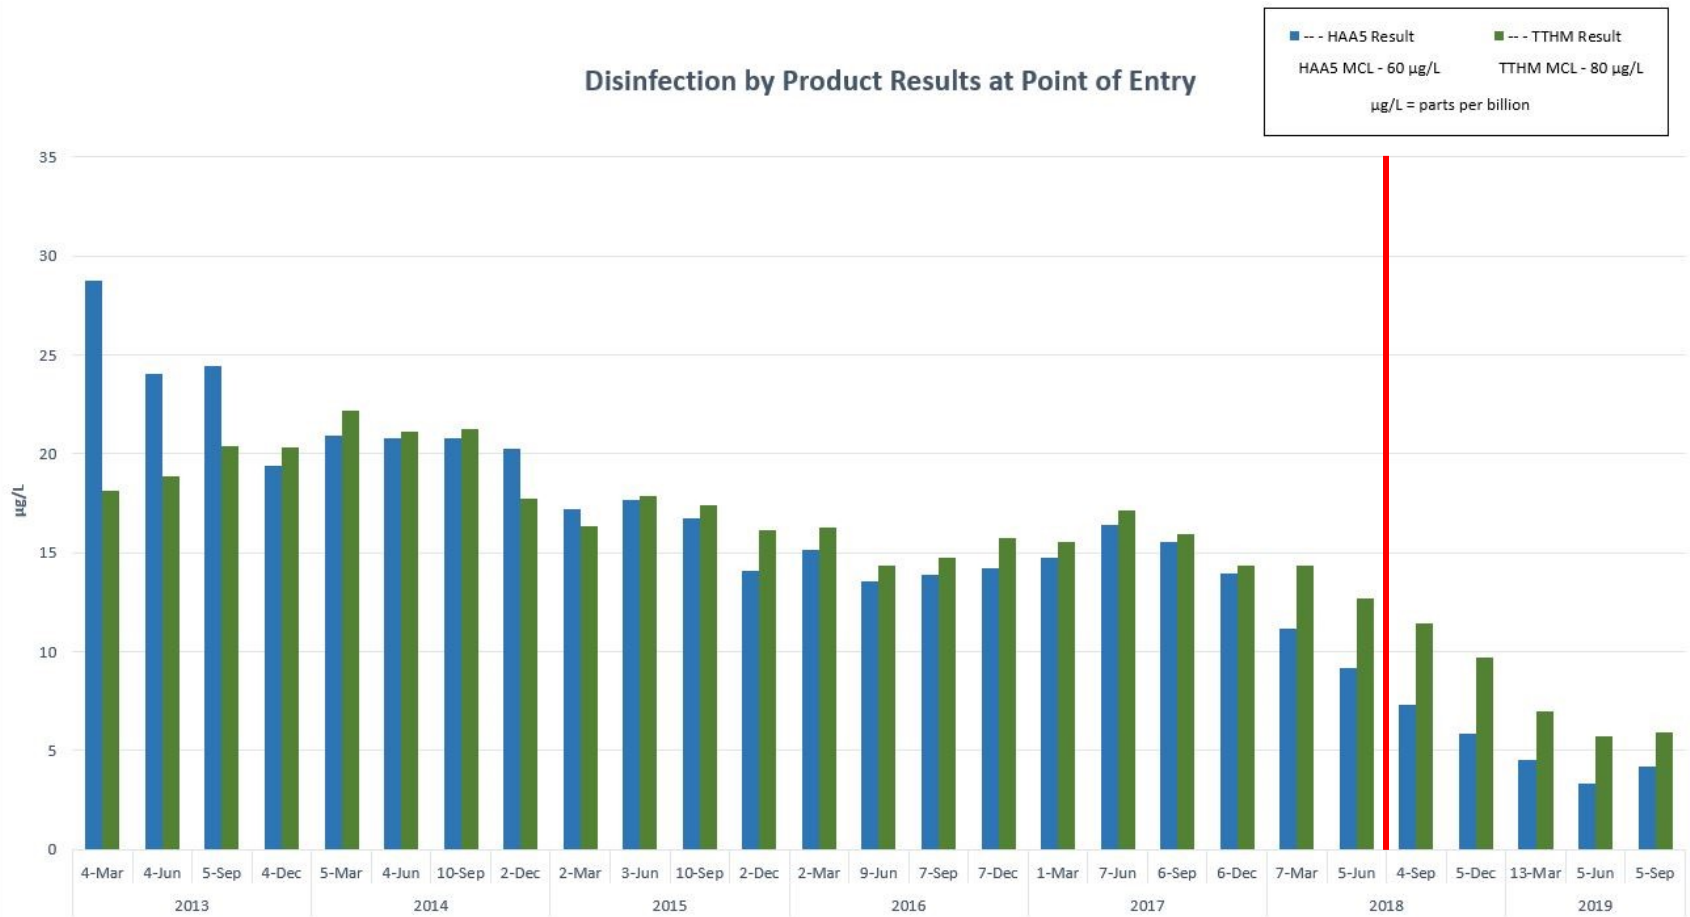

Note: The red line indicates when biofiltration was added to the treatment process which further reduced organic material in the water.